


FRONT

SIDE

ELECTRIC SERVICE INSTALLATION

- Size larger as needed.
- Or as directed by Utility Company.

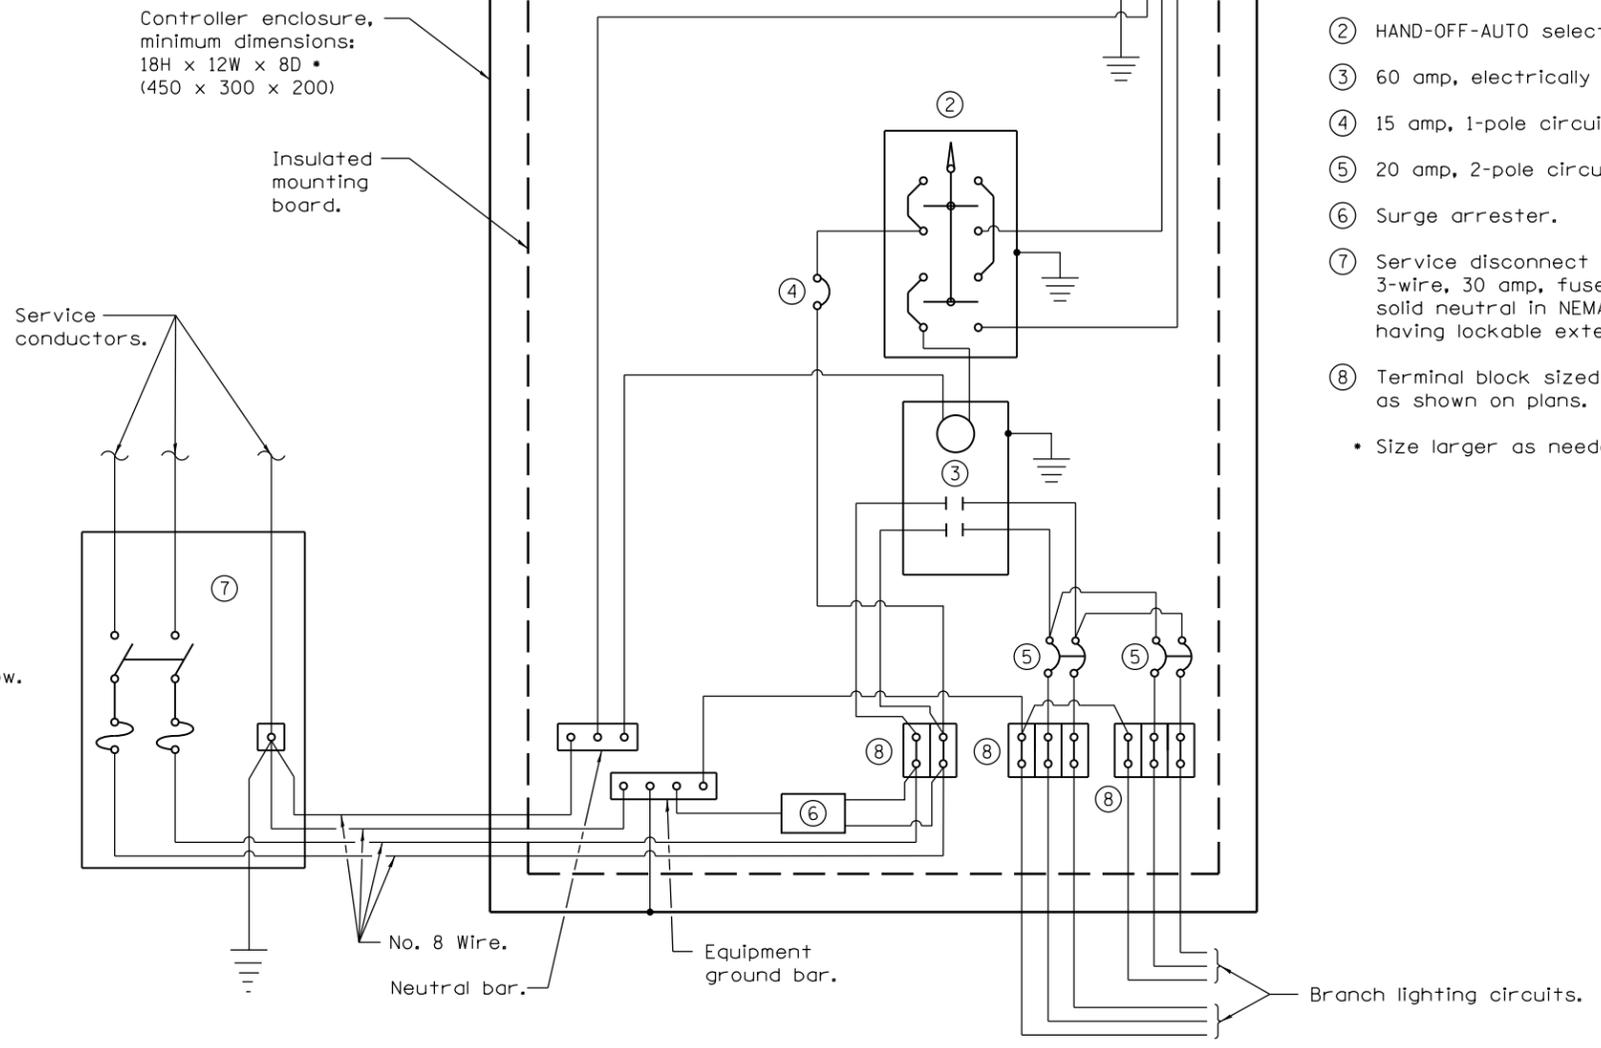

CONTROL SCHEMATIC

- ① Photocell with integral surge arrester.
 - ② HAND-OFF-AUTO selector switch.
 - ③ 60 amp, electrically held contactor.
 - ④ 15 amp, 1-pole circuit breaker.
 - ⑤ 20 amp, 2-pole circuit breaker.
 - ⑥ Surge arrester.
 - ⑦ Service disconnect switch - 2-pole, 3-wire, 30 amp, fused at 30 amp, solid neutral in NEMA 4X enclosure having lockable external handle.
 - ⑧ Terminal block sized for conductors as shown on plans.
- Size larger as needed.

GENERAL NOTES

Provide 12x9x1 (305x225x25) watertight pouch mounted inside controller door with as-built plans and schematics.

Provide engraved nameplate on front of enclosure reading "LIGHTING".

Enclosure shall be mounted to pole with pole-bands and lag-bolts.

Work pad not shown.

All dimensions are in inches (millimeters) unless otherwise shown.

Illinois Department of Transportation

PASSED April 1, 2016

ENGINEER OF PRELIMINARY ENGINEERING

APPROVED April 1, 2016

ENGINEER OF DESIGN AND ENVIRONMENT


ISSUED 1-1-10

| DATE | REVISIONS |
|--------|---|
| 4-1-16 | Corrected connection at terminal block. |
| 1-1-15 | Added notes ⑧ for 30A controller, ① for 60A controller. |

**LIGHTING CONTROLLER
POLE MOUNTED, 240V**


(Sheet 1 of 2)

STANDARD 825001-03

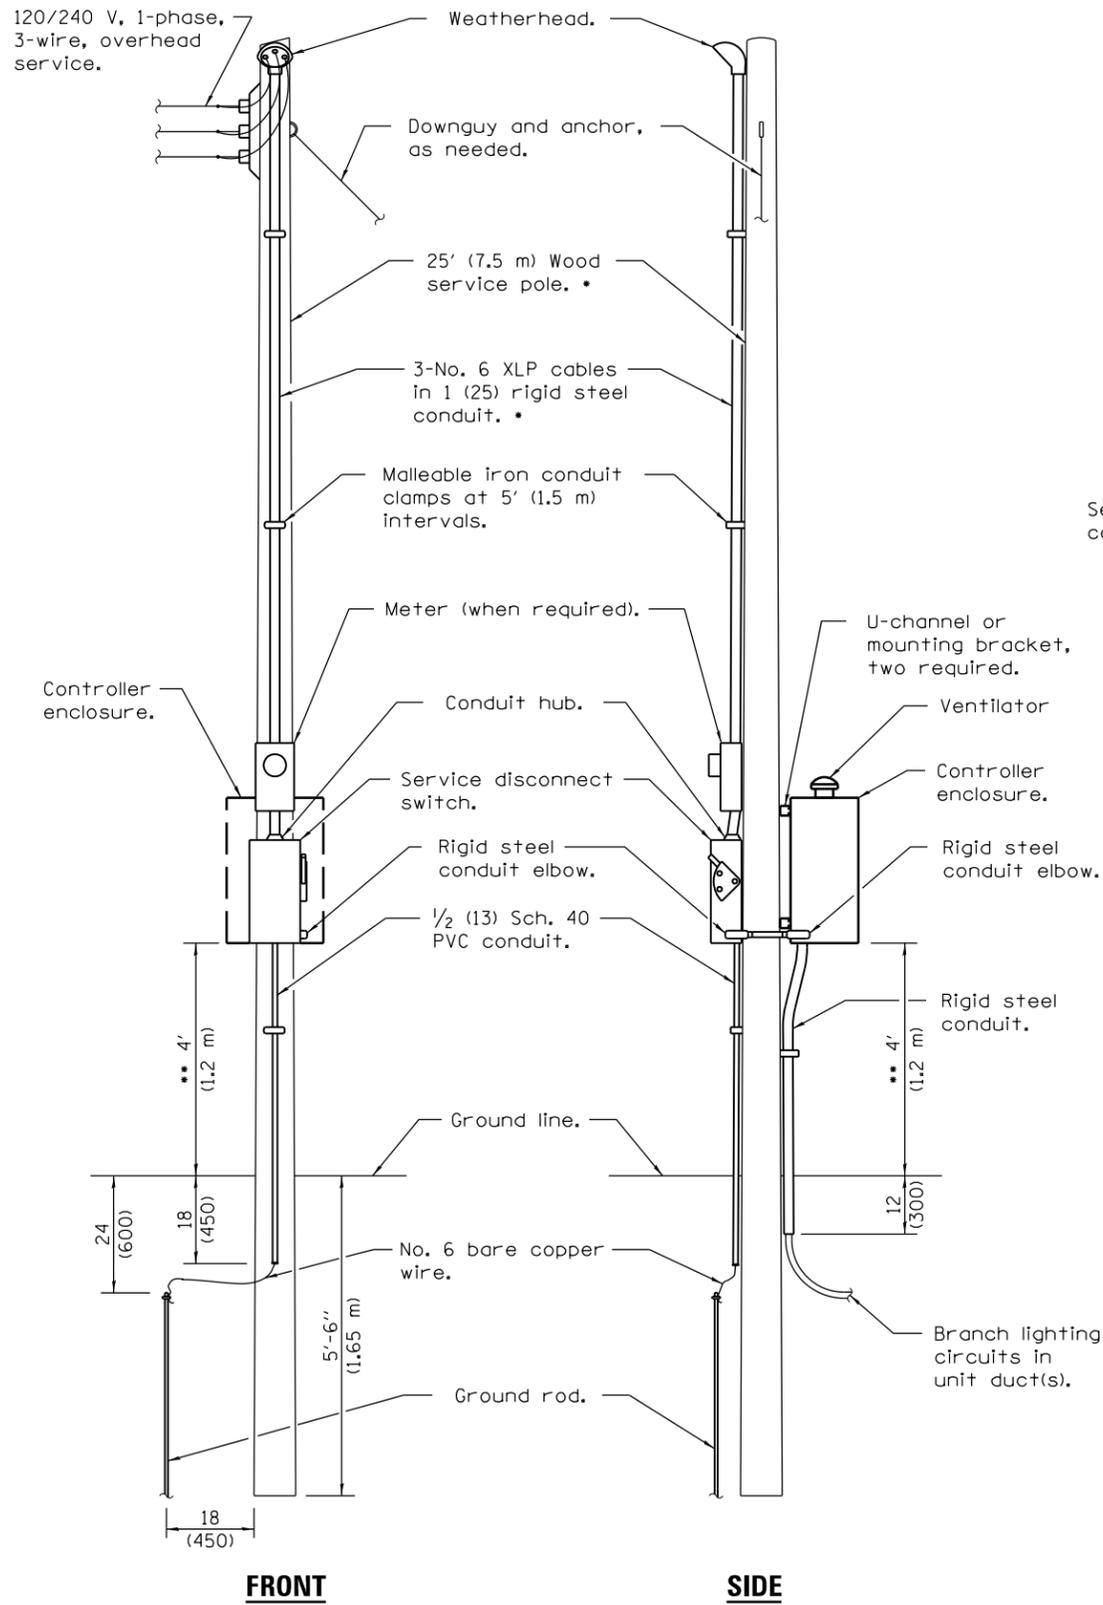

ELECTRIC SERVICE INSTALLATION

* Size larger as needed.
 ** Or as directed by Utility Company.

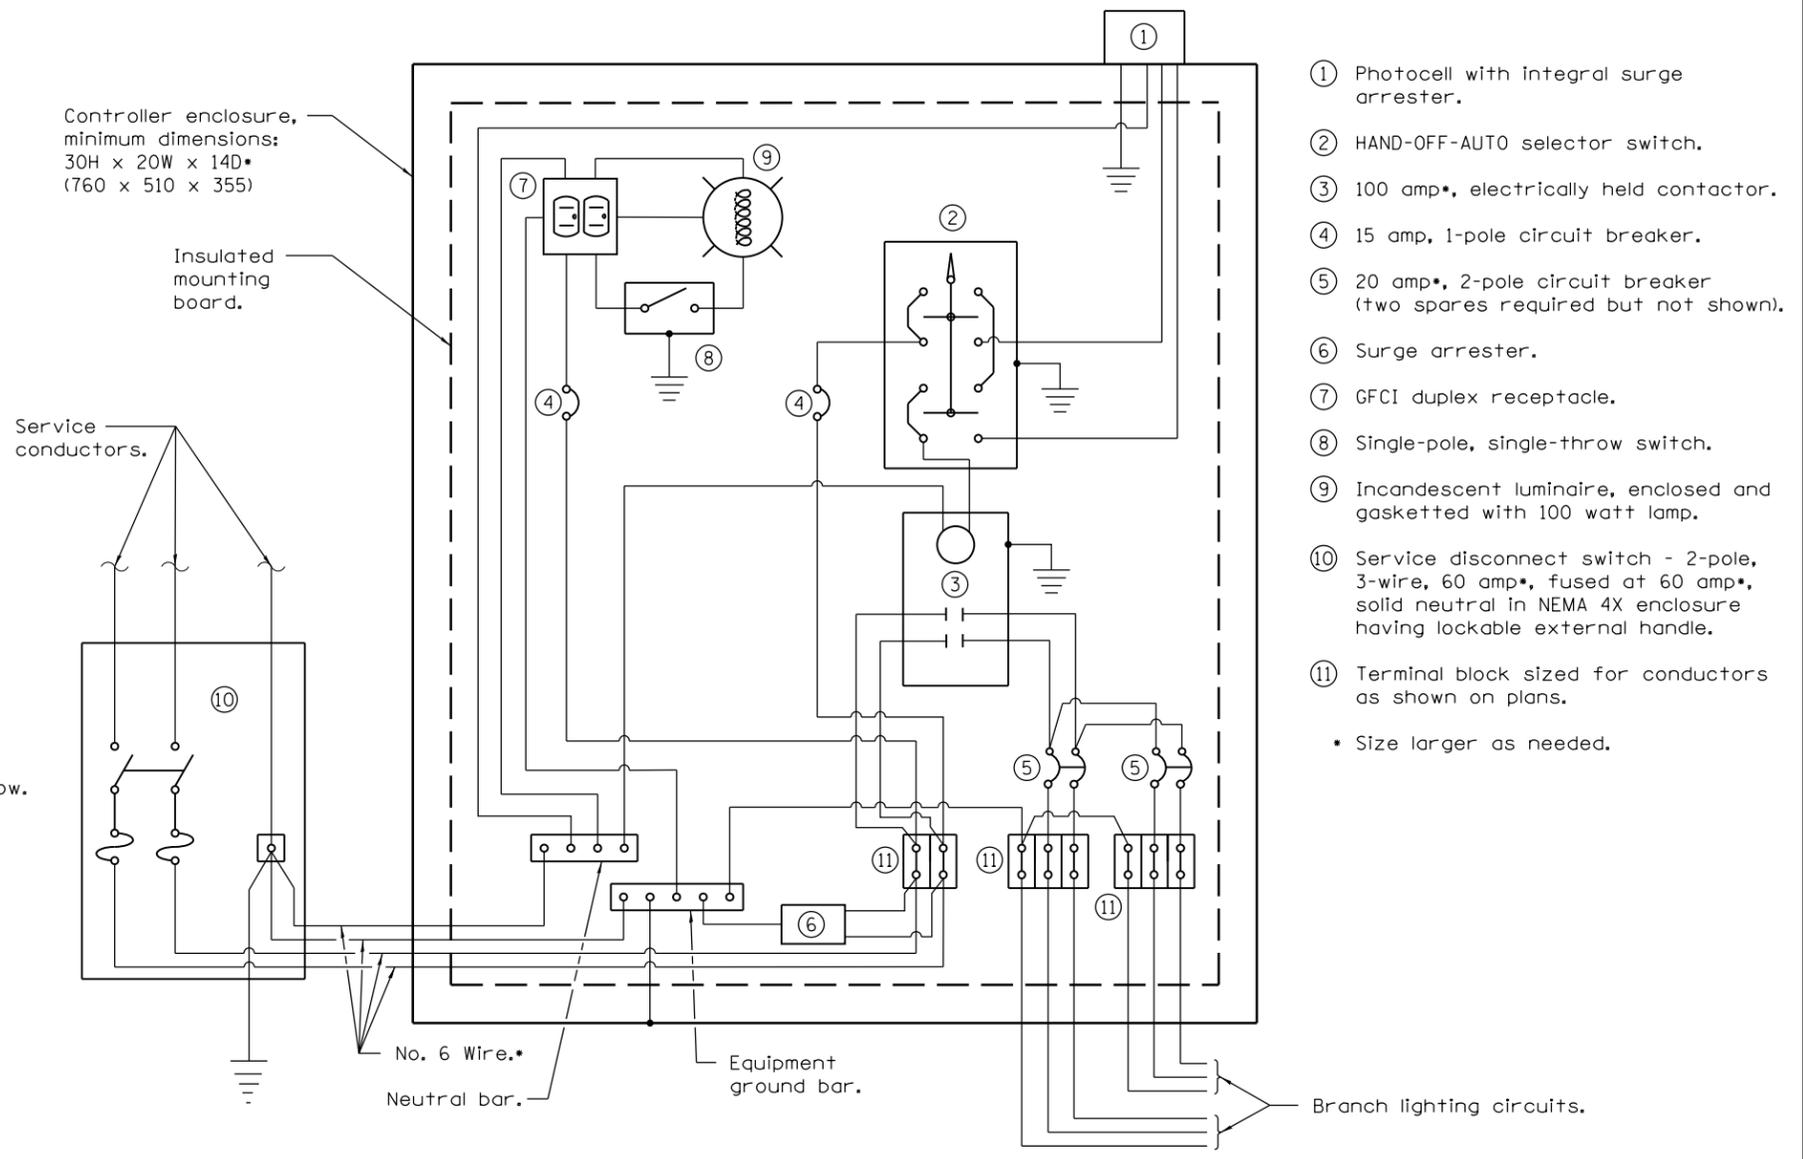

- ① Photocell with integral surge arrester.
- ② HAND-OFF-AUTO selector switch.
- ③ 100 amp*, electrically held contactor.
- ④ 15 amp, 1-pole circuit breaker.
- ⑤ 20 amp*, 2-pole circuit breaker (two spares required but not shown).
- ⑥ Surge arrester.
- ⑦ GFCI duplex receptacle.
- ⑧ Single-pole, single-throw switch.
- ⑨ Incandescent luminaire, enclosed and gasketed with 100 watt lamp.
- ⑩ Service disconnect switch - 2-pole, 3-wire, 60 amp*, fused at 60 amp*, solid neutral in NEMA 4X enclosure having lockable external handle.
- ⑪ Terminal block sized for conductors as shown on plans.

* Size larger as needed.

Illinois Department of Transportation

PASSED April 1, 2016

ENGINEER OF PRELIMINARY ENGINEERING

APPROVED April 1, 2016

ENGINEER OF DESIGN AND ENVIRONMENT

ISSUED 1-1-10

LIGHTING CONTROLLER

POLE MOUNTED, 240V

(Sheet 2 of 2)

STANDARD 825001-03